

# PM10 HI-VOLUME SAMPLER DATA


Table 8 Truckee Fire Station

	ANNUAL ARITHMETIC MEAN	HIGHEST 24 HOUR CONCENTRATION	DAYS EXCEEDING STATE STANDARD	DAYS EXCEEDING NATIONAL STANDARD
1988	33.8	97	13	0
1989	30.2	91	6	0
1990	32.1	112	14	0
1991	33.4	110	15	0
1992	32.4	138	9	0
1993	40.8	145	9	0
1994	37	119	10	0
1995	34	95	9	0
1996	28	80	7	0
1997	31.7	136	11	0
1998	24.7	71	4	0
1999	27.9	82	6	0
2000 <sup>1</sup>	22.6	49	0	0
2001	<b>Sampler was not operated during 2001.</b>			
2002 <sup>2</sup>	19.6	35	0	0
2003	20.1	64	1	0
2004 <sup>3</sup>	28.6	78	10	0
2005	26.5	150	4	0

\1 - Represents 6 months of data, January thru June. Sampler was removed from service in July, 2000.

\2 - Sampler was put back into service May, 2002.

\3 - Wedding sampler was removed and all of 2004 data is from an Andersen 1200 Hi-Volume Volumetric Sampler

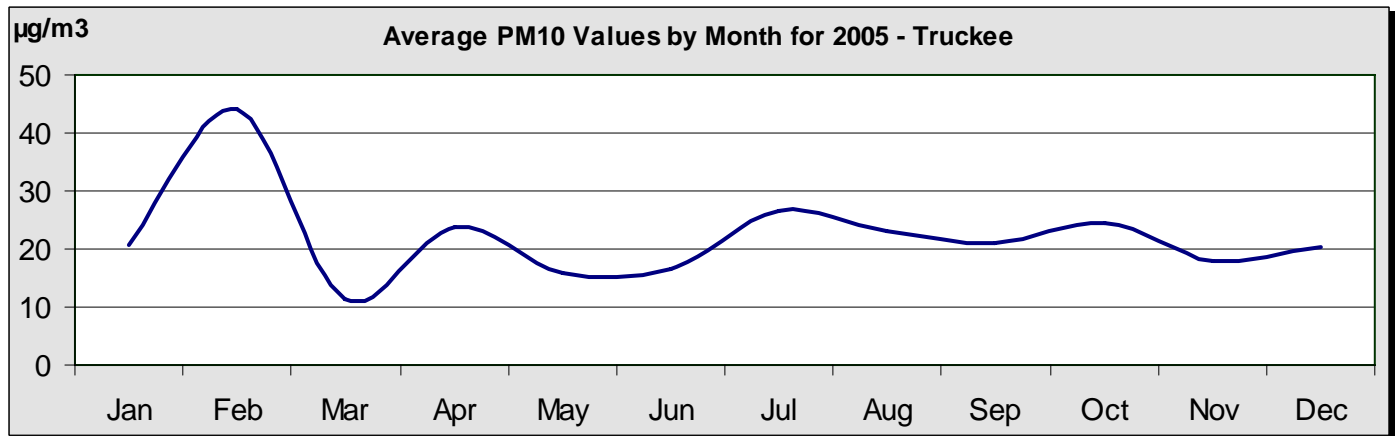

**AMBIENT AIR QUALITY STANDARDS FOR PM10:**

**NATIONAL:** 24 Hour Average: 150 µg/m<sup>3</sup>  
Annual Arithmetic Mean: 50 µg/m<sup>3</sup>

**CALIFORNIA:** 24 Hour Average: 50 µg/m<sup>3</sup>  
Annual Arithmetic Mean: 20 µg/m<sup>3</sup>